

# KINCAID ♦ BRYANT

Consulting Engineers

A professional corporation

---

**Mechanical • Electrical • Plumbing • Fire Protection • Value Engineering**

1085 Vista Park Drive • Suite A • Forest, VIRGINIA • 24551  
PHONE: 434-846-6510 FAX: 434-846-0005

To: **All Document Holders**

From: **KINCAID ♦ BRYANT**

Date: August 19, 2009

Comm. No.: 08103

Project: SWVTC – Replace Ductwork in Buildings 1, 2, 9 and 10  
Project Code: 720-10880-38-11

RE: **Addendum No. 3**

---

Gentlemen:

Enclosed for your information is a copy of Addendum No. 3, including changes and modifications to the Specifications and Drawings, for the above referenced project.

Please attach this addendum to all copies of the Contract Documents in your possession so that they may be brought up-to-date.

Acknowledgment of receipt of this addendum is required on the Bid Form.

Sincerely,  
KINCAID ♦ BRYANT



David A. Kincaid, PE

Enclosure

# KINCAID ♦ BRYANT

**Consulting Engineers**

A professional corporation

---

**Mechanical • Electrical • Plumbing • Fire Protection • Value Engineering**

1086 Vieta Park Drive • Suite A • Forest, VIRGINIA • 24551  
PHONE: 434-846-8610 FAX: 434-846-0006

To: **All Document Holders**

From: **KINCAID ♦ BRYANT**

Date: August 19, 2009

Comm. No.: 08103

Project: SWVTC – Replace Ductwork in Buildings 1, 2, 9 and 10  
Project Code: 720-10880-38-11

RE: **Addendum No. 3**

---

At the time of submission of bids, written acknowledgment of receipt of this Addendum by the Bidder shall be made in the appropriate blank on the Bid Form.

This Addendum has been issued to all Document Holders on record with our office. Bidders shall see that all Sub-Contractors are properly notified of the applicable provisions herein.

The information in this Addendum supersedes any contradictory information or omission set forth in the Contract Documents, including all previous addendums.

**Addendum No. 3, dated August 19, 2009, to Bidding Documents for Southwestern Virginia Training Center – Hillsville, Virginia: Replace Ductwork in Buildings 1, 2, 9 and 10, Plans and Specifications dated May 22, 2009, K♦B File No. 08103, Project Code: 720-10880-38-11.**

**TO: PLAN HOLDERS OF RECORD**

**FROM: KINCAID ♦ BRYANT, Consulting Engineers  
725 Church Street, 7<sup>th</sup> Floor  
Allied Arts Building  
Lynchburg, VA 24504**

---

***This Addendum forms a part of the Contract Documents and modifies the Plans and Specifications dated May 22, 2009, as noted below. Acknowledge receipt of this Addendum on the Bid Form. Failure to do so may subject Bidder to disqualification.***

---

**Addendum No. 2:**

**Drawing E2:** Delete references to Sketch SK-1 and SK-2.

**Drawing E6:** Delete reference to Sketch SK-3.

**DRAWINGS**

**M1:**

- Delete the following in its entirety:

**“General Note**

Means of egress shall be accessible to all times during construction. All ceilings removed during construction shall be covered at the end of each construction day. When construction work requires the sprinkler system to be shut-down for more than 4 hours, the Facility shall provide a fire watch for 24 hours / 7 days a week and post a log-in, log-out record sheet.”

And add the following:

**“General Note**

Means of egress shall be accessible to all times during construction. All ceilings removed during construction shall be covered at the end of each construction day. When construction work requires the sprinkler system to be shut-down for more than 4 hours, the Contractor shall provide a fire watch for 24 hours / 7 days a week and post a log-in, log-out record sheet.”

**A2:**

- See attached Sketch No. SK-1.
- See attached Sketch No. SK-2.

**A6:**

- See attached Sketch No. SK-3.

**END OF ADDENDUM NO. 3**

# KINCAID • BRYANT

A KINCAID BRYANT, PC COMPANY

MECHANICAL • ELECTRICAL • PLUMBING • STRUCTURAL • FIRE PROTECTION

LYNCHBURG

1085 VISTA PARK DRIVE, SUITE A  
FOREST, VA 24551

PHONE: 434-846-6510 FAX: 434-846-0005


RICHMOND

9464 CHAMBERLAYNE RD  
MECHANICSVILLE, VA 23116

PHONE: 804-730-0011 FAX: 804-730-4012

By: DAC	Date: 17 AUG 09	Proj. No.: 08103	Rev: 1	SK No.: SK-1
Client: COMMONWEALTH OF VIRGINIA DBHDS				DWG No.: 08103AE02
Project: SOUTHWESTERN VIRGINIA TRAINING CENTER				Page: 1 of 8
Subject: REPLACE DUCTWORK BUILDINGS 1, 2, 9, AND 10				

- 8 EXISTING MAKE-UP AIR UNITS TO BE REMOVED COMPLETELY, REFER TO MECHANICAL DRAWINGS. TEMPORARILY SEAL ALL CEILING AND ROOF PENETRATIONS.
  - 9 DISCONNECT AND REMOVE EXISTING ELECTRICAL RACEWAY.
  - 10 REMOVE HARD CEILING/SOFFIT THIS AREA.
  - 11 SOFFIT TO REMAIN IN PLACE UNDISTURBED.
- 1

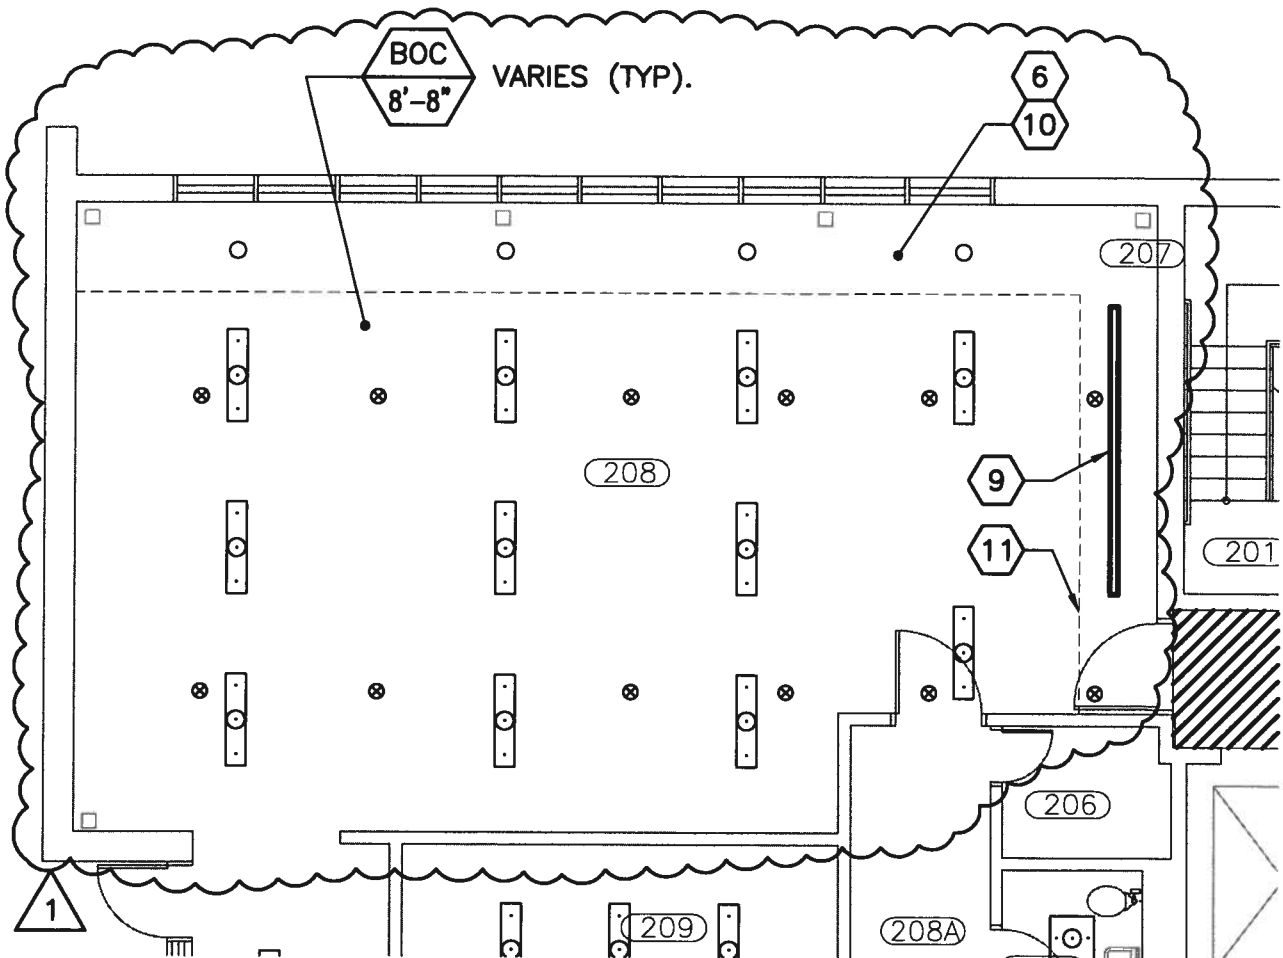

# KINCAID • BRYANT

A KINCAID BRYANT, PC COMPANY

MECHANICAL • ELECTRICAL • PLUMBING • STRUCTURAL • FIRE PROTECTION

LYNCHBURG

1085 VISTA PARK DRIVE, SUITE A  
FOREST, VA 24551


PHONE: 434-846-6510 FAX: 434-846-0005

RICHMOND

9464 CHAMBERLAYNE RD  
MECHANICSVILLE, VA 23116

PHONE: 804-730-0011 FAX: 804-730-4012

By: DAC	Date: 17 AUG 09	Proj. No.: 08103	Rev: 1	SK No.: SK-2
Client: COMMONWEALTH OF VIRGINIA DBHDS				DWG No.: 08103AE02
Project: SOUTHWESTERN VIRGINIA TRAINING CENTER				Page: 2 of 8
Subject: REPLACE DUCTWORK BUILDINGS 1, 2, 9, AND 10				

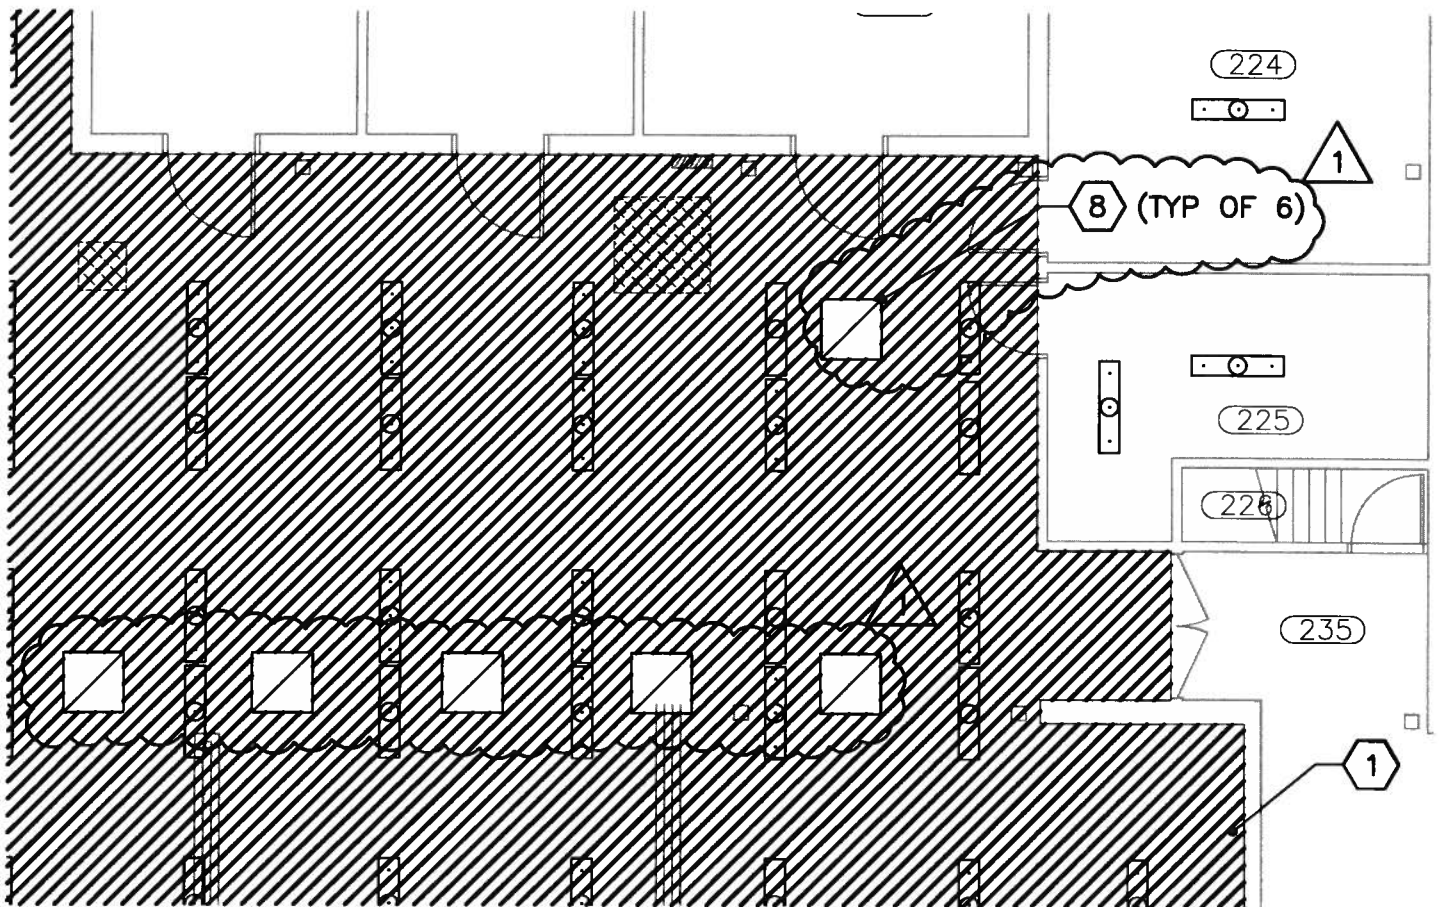

# KINCAID • BRYANT

A KINCAID BRYANT, PC COMPANY

MECHANICAL • ELECTRICAL • PLUMBING • STRUCTURAL • FIRE PROTECTION

LYNCHBURG

1085 VISTA PARK DRIVE, SUITE A  
FOREST, VA 24551

PHONE: 434-846-6510 FAX: 434-846-0005

RICHMOND

9464 CHAMBERLAYNE RD  
MECHANICSVILLE, VA 23116

PHONE: 804-730-0011 FAX: 804-730-4012

By: DAC	Date: 17 AUG 09	Proj. No.: 08103	Rev: 1	SK No.: SK-3
Client: COMMONWEALTH OF VIRGINIA DBHDS				DWG No.: 08103AE06
Project: SOUTHWESTERN VIRGINIA TRAINING CENTER				Page: 3 of 8
Subject: REPLACE DUCTWORK BUILDINGS 1, 2, 9, AND 10				

4 EXISTING SOFFIT TO REMAIN IN PLACE FOR DUCTWORK CONCEALMENT. INSTALL NEW LAY-IN CEILING TIGHT AGAINST SOFFIT.

1

